
Comfort-Aire®


Century®

REPLACEMENT PARTS LIST

CEILING CASSETTE

B-VHP09CA-1

EXPLODED VIEW

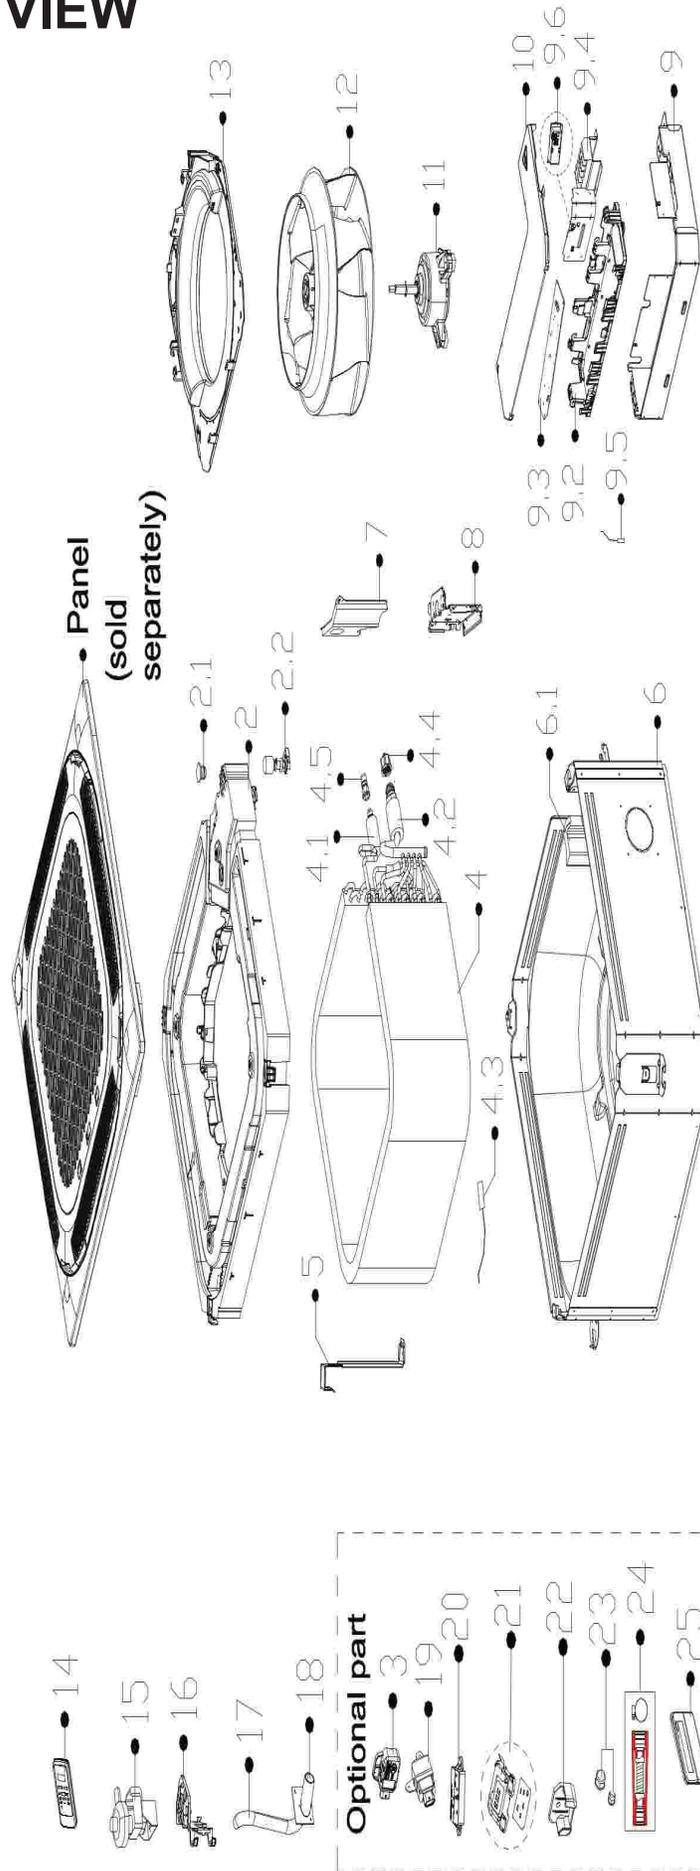

REPLACEMENT PARTS

Location	Part Name	Quantity	Part No.
2	Water collector subassembly	1.00	12822500000650
2.1	Drain stopper	1.00	12600801000903
2.2	Water Level Switch	1.00	17400511001424
3	Gas sensor	1.00	11201003000344
4	Evaporator Assembly	1.00	15822500003184
4.1	Evaporator inlet pipe subassembly	1.00	15122500003898
4.2	Evaporator outlet pipe subassembly	1.00	15122500003956
4.3	Pipe Temperature Sensor	1.00	11201007003442
4.4	Pipe Nut	1.00	15500404000148
4.5	Pin Valve	1.00	15500209000001
5	Evaporator fixing hanger	1.00	12222500002852
6	Chassis assembly	1.00	12222500002836
6.1	Base foam subassembly	1.00	12822500000630
7	Pipe fixing board subassembly	1.00	12222500002835
8	Evaporator connecting board	1.00	12222500002853
9	Electronic Control Box Subassembly	1.00	17222500005586
9.2	Insulation plate	1.00	12122500002849
9.3	Main Control Board Subassembly	1.00	17122500007498
9.4	Wire Joint	1.00	17400401000136
9.5	Room Temperature Sensor	1.00	11201007006664
9.6	Sensor subassembly	1.00	17122000061576
10	Cover of electronic control box	1.00	12222500002837
11	Brushless DC Motor	1.00	11002015019336
12	Centrifugal Fan	1.00	12100103001644
13	Ventilation ring	1.00	12122500002851
14	Remote Controller	1.00	17317000A71930
15	Shaded pole pump	1.00	11001012001231
16	Water Pump Box	1.00	12122500002850
17	Rubber tube	1.00	12600501002808
18	Drain Pipe	1.00	12100510000019
22	Bracket of Remote Controller	1.00	12122000029201
23	Flare Nut	1.00	15500406000015
23	Flare Nut	1.00	15500406000016
24	Accessory Kit Of The Drainage Pipe Assembly	1.00	12011600005258
26	Magnetic ring	2.00	11201103000001

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer. Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Incentive and rebate programs have precise requirements as to product performance and certification. All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product. Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.



1900 Wellworth Avenue • Jackson, MI 49203 • 517-787-2100

Comfort-Aire®


Century®

REPLACEMENT PARTS LIST

CEILING CASSETTE

B-VHP12CA-1

EXPLODED VIEW

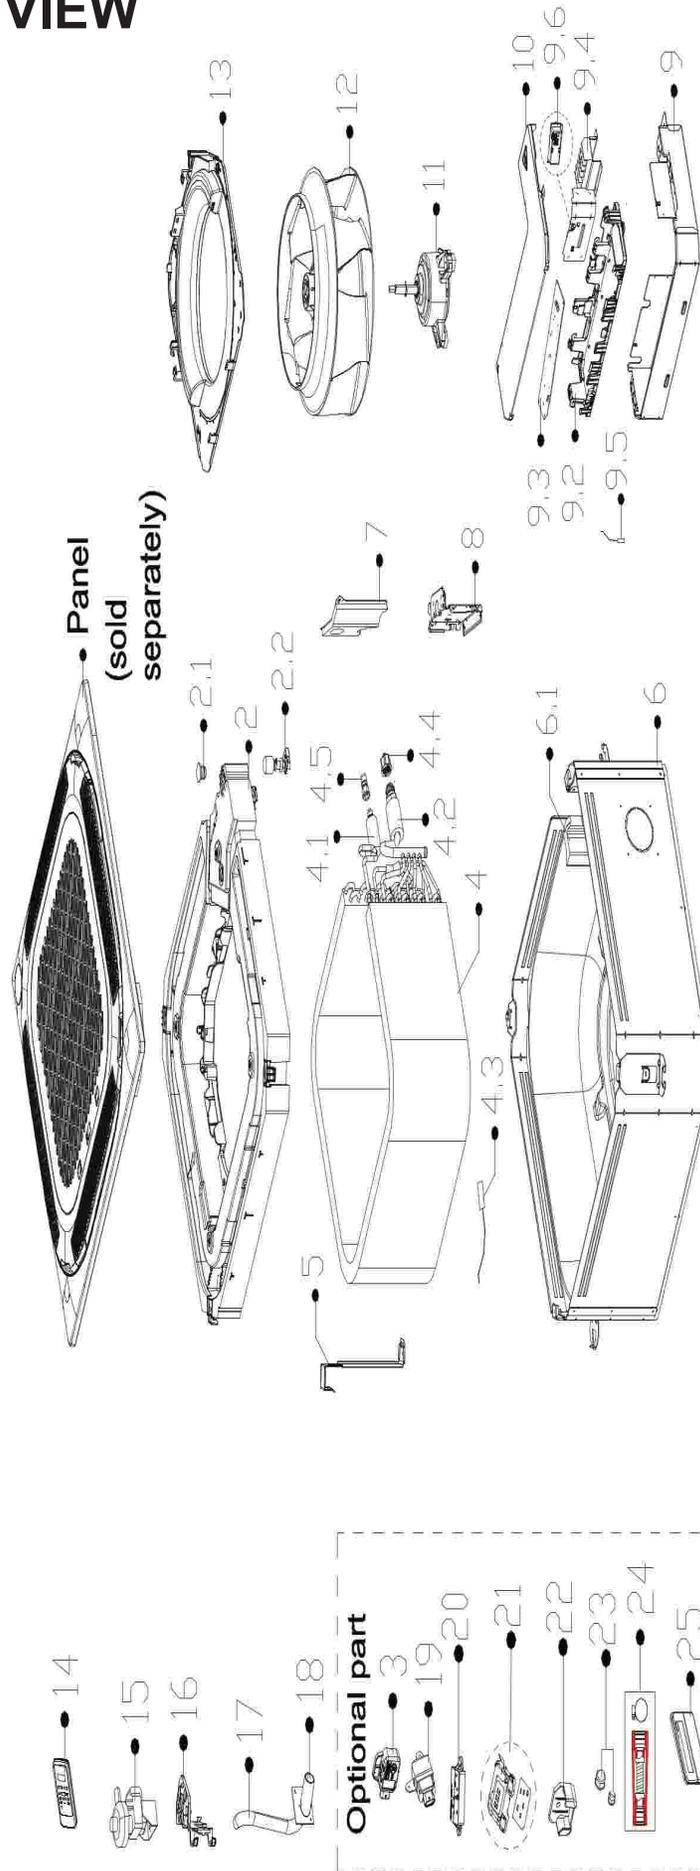

REPLACEMENT PARTS

Location	Part Name	Quantity	Part No.
2	Water collector subassembly	1.00	12822500000650
2.1	Drain stopper	1.00	12600801000903
2.2	Water Level Switch	1.00	17400511001424
3	Gas sensor	1.00	11201003000344
4	Evaporator Assembly	1.00	15822500003184
4.1	Evaporator inlet pipe subassembly	1.00	15122500003898
4.2	Evaporator outlet pipe subassembly	1.00	15122500003956
4.3	Pipe Temperature Sensor	1.00	11201007003442
4.4	Pipe Nut	1.00	15500404000148
4.5	Pin Valve	1.00	15500209000001
5	Evaporator fixing hanger	1.00	12222500002852
6	Chassis assembly	1.00	12222500002836
6.1	Base foam subassembly	1.00	12822500000630
7	Pipe fixing board subassembly	1.00	12222500002835
8	Evaporator connecting board	1.00	12222500002853
9	Electronic Control Box Subassembly	1.00	17222500005587
9.2	Insulation plate	1.00	12122500002849
9.3	Main Control Board Subassembly	1.00	17122500007511
9.4	Wire Joint	1.00	17400401000136
9.5	Room Temperature Sensor	1.00	11201007006664
9.6	Sensor subassembly	1.00	17122000061576
10	Cover of electronic control box	1.00	12222500002837
11	Brushless DC Motor	1.00	11002015019336
12	Centrifugal Fan	1.00	12100103001644
13	Ventilation ring	1.00	12122500002851
14	Remote Controller	1.00	17317000A71930
15	Shaded pole pump	1.00	11001012001231
16	Water Pump Box	1.00	12122500002850
17	Rubber tube	1.00	12600501002808
18	Drain Pipe	1.00	12100510000019
22	Bracket of Remote Controller	1.00	12122000029201
23	Flare Nut	1.00	15500406000015
23	Flare Nut	1.00	15500406000016
24	Accessory Kit Of The Drainage Pipe Assembly	1.00	12011600005258
26	Magnetic ring	2.00	11201103000001

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer. Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Incentive and rebate programs have precise requirements as to product performance and certification. All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product. Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.

Comfort-Cire® **Century**®

1900 Wellworth Avenue • Jackson, MI 49203 • 517-787-2100

Comfort-Aire®


Century®

REPLACEMENT PARTS LIST

CEILING CASSETTE

B-VHP18CA-1

EXPLODED VIEW

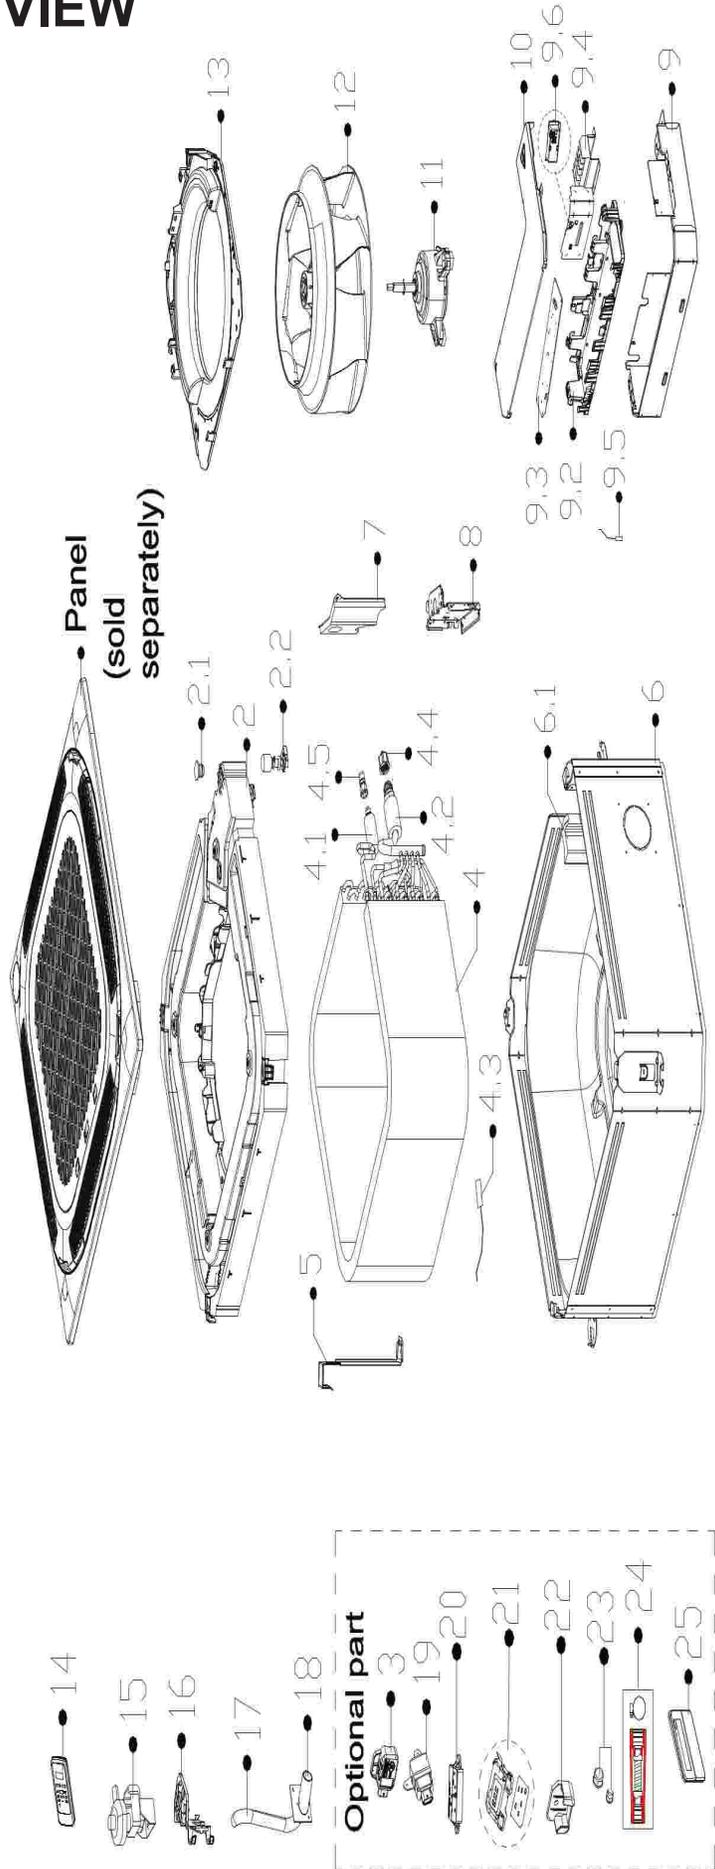

REPLACEMENT PARTS

Location	Part Name	Quantity	Part No.
2	Water collector subassembly	1.00	12822500000650
2.1	Drain stopper	1.00	12600801000903
2.2	Water Level Switch	1.00	17400511001424
3	Gas sensor	1.00	11201003000344
4	Evaporator Assembly	1.00	15822500003182
4.1	Evaporator inlet pipe subassembly	1.00	15122500003898
4.2	Evaporator outlet pipe subassembly	1.00	15122500003897
4.3	Pipe Temperature Sensor	1.00	11201007003442
4.4	Pipe Nut	1.00	15500404000147
4.5	Pin Valve	1.00	15500209000001
5	Evaporator fixing hanger	1.00	12222500002852
6	Chassis assembly	1.00	12222500002836
6.1	Base foam subassembly	1.00	12822500000630
7	Pipe fixing board subassembly	1.00	12222500002835
8	Evaporator connecting board	1.00	12222500002853
9	Electronic Control Box Subassembly	1.00	17222500005592
9.2	Insulation plate	1.00	12122500002849
9.3	Main Control Board Subassembly	1.00	17122500007496
9.4	Wire Joint	1.00	17400401000136
9.5	Room Temperature Sensor	1.00	11201007006664
9.6	Sensor subassembly	1.00	17122000061576
10	Cover of electronic control box	1.00	12222500002837
11	Brushless DC Motor	1.00	11002015019336
12	Centrifugal Fan	1.00	12100103001644
13	Ventilation ring	1.00	12122500002851
14	Remote Controller	1.00	17317000A71930
15	Shaded pole pump	1.00	11001012001231
16	Water Pump Box	1.00	12122500002850
17	Rubber tube	1.00	12600501002808
18	Drain Pipe	1.00	12100510000019
22	Bracket of Remote Controller	1.00	12122000029201
23	Flare Nut	1.00	15500406000012
23	Flare Nut	1.00	15500406000016

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer. Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Incentive and rebate programs have precise requirements as to product performance and certification. All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product.

Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.

Comfort-Aire®  **Century**®

1900 Wellworth Avenue • Jackson, MI 49203 • 517-787-2100





REPLACEMENT PARTS LIST

CEILING CASSETTE

B-VHP24CA-1

EXPLODED VIEW

Optional function parts

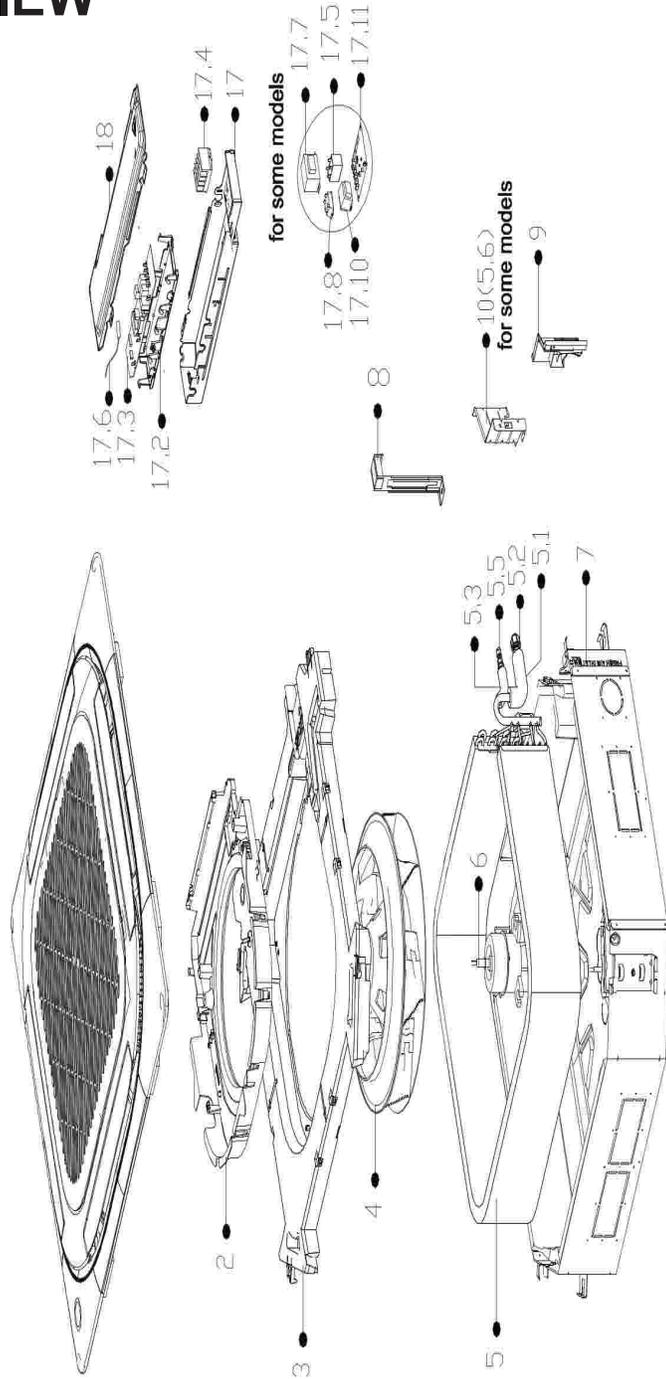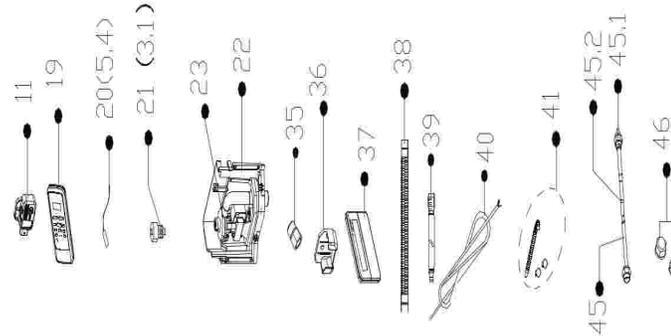

REPLACEMENT PARTS

Location	Part Name	Quantity	Part No.
2	Air Guide Ring	1.00	12122500002031
3	Water collector subassembly	1.00	12822500A00067
3.1	Water Level Switch	1.00	17400511001244
4	Centrifugal Fan	1.00	12100103A00122
5	Evaporator Assembly	1.00	15822500003185
5.1	Evaporator outlet pipe subassembly	1.00	15122500003156
5.2	Pipe Nut	1.00	15500404000145
5.3	Evaporator inlet pipe subassembly	1.00	15122500003237
5.4	Pipe Temperature Sensor	1.00	11201007003442
5.5	Pin Valve	1.00	15500209000002
6	Brushless DC Motor	1.00	11002015A01557
7	Chassis Assembly	1.00	12222500002035
8	Evaporator Fixing Hanger	1.00	12222500000084
9	Pipe fixing board subassembly	1.00	12122500002028
10	Evaporator fixing board subassembly	1.00	12222500001673
11	Gas sensor	1.00	11201003000344
17	Electronic Control Box Subassembly	1.00	17222500005589
17.2	Insulation Plate	1.00	12122500002047
17.3	Main Control Board Subassembly	1.00	17122500007491
17.4	Wire Joint	1.00	17400401006536
17.6	Room Temperature Sensor	1.00	11201007003424
17.7	Reactor	1.00	17400306000923
17.11	Humidity Sensor Subassembly	1.00	17122000053682
18	Electric Control Box Cover	1.00	12222500002033
19	Remote Controller	1.00	17317000A71930
22	External Water Pump Box Assembly	1.00	12122500003147
23	Induction Pump	1.00	11001010001757
33	rubber base	1.00	12600401006153
36	Bracket of Remote Controller	1.00	12122000029201
41	Accessory Kit Of The Drainage Pipe Assembly	1.00	12011600005258
42	Accessory Kit	1.00	12022500000002
46	Flare Nut	1.00	15500406000003
46	Flare Nut	1.00	15500406000015
55	rubber base	1.00	12600401006153

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer. Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Incentive and rebate programs have precise requirements as to product performance and certification. All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product. Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.

Comfort-Cire®  **Century**®

1900 Wellworth Avenue • Jackson, MI 49203 • 517-787-2100